


Technical Data Sheet

Astro HPE Sealant

UIC of product-type: AFHPE

Revision 13 - 22nd February 2024

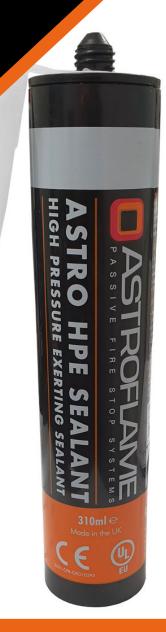







ETA-Danmark A/S Göteborg Plads 1 DK-2150 Nordhavn Tel. +45 72 24 59 00 Internet www.etadanmark.dk

Authorised and notified according to Article 29 of the Regulation (EU)
No 305/2011 of the European Parliament and of the Council of 9 March 2011



European Technical Assessment ETA-20/1090 of 2023/11/23

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the construction product:

ASTRO HPE Sealant

Product family to which the above construction product belongs:

Fire Stopping, Fire Sealing & Fire Protective Products. Fire Retardant Products

Manufacturer:

Astroflame (fireseals) Limited Unit 8 The IO Centre Stephenson Road Segensworth, Fareham Hampshire PO15 5RU

Manufacturing plant:

E055

This European Technical Assessment contains:

51 pages including 3 annexes which form an integral part of the document

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of:

EAD 350454-00-1104 Firestopping and fire sealing products, Penetration Seals

This version replaces:

The ETA with the same number issued on 2020-12-09

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full [except the confidential Annex(es) referred to above]. However, partial reproduction may be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

1 Technical Description of the Product

- 1) ASTRO HPE Sealant is an acrylic based graphite sealant used to reinstate the fire resistance performance of wall and floor constructions where they have been provided with apertures for the penetration of single or multiple services.
- 2) ASTRO HPE Sealant is gun applied to annular space around the service(s) to the required depth (for details see Annex C)
- 3) ASTRO HPE Sealant is supplied in 330ml catridges and 400ml foils.
- 4) ASTRO HPE Sealant can be installed in conjunction with Astro Batt and coating in accordance with ETA-20/1091

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The intended use of ASTRO HPE Sealant is to reinstate the fire resistance performance of rigid and flexible walls and rigid floor constructions where they are penetrated by various cables, cable trays and plastic and insulated metallic pipes.

1) The specific elements of construction that the system ASTRO HPE Sealant may be used to provide a penetration seal in, are as follows:

Rigid The wall must have a minimum thickness of at least 100 mm – as specified in

walls: annex C – and comprise concrete, aerated concrete or masonry, with a

minimum density of 650 kg/m3.

Rigid The floor must have a minimum thickness of at least 150 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m3.

noors. Concrete, derated concrete or masonly, with a minimum density of 050 kg/ms

Flexible The wall must have a minimum thickness of at least 100 mm – as specified in walls annex C – and comprise timber or steel studs lined on both faces with minimum

2 layers of 12.5 mm thick, gypsum boards according to EN 520. In timber stud walls, no part of the penetration shall be closer than 100 mm to a stud, the cavity must be closed between the penetration seal and the stud and minimum 100 mm of insulation of class A1 or A2 according to EN 13501-1, is provided

within the cavity between the penetration seal and the stud.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- 2) The ASTRO HPE Sealant may be used to provide a penetration seal with plastic and insulated metallic pipes, and cables and cable trays (for details see Annex C).
- 3) The total amount of cross sections of services (including insulation) should not exceed 60% of the penetration area.
- 4) The ASTRO HPE Sealant may be used to seal apertures in the wall separating element up to 100mm wide by 300mm high. The ASTRO HPE Sealant may be used to seal apertures in the floor separating element up to 250mm wide by 250mm high. The minimum permitted separation between adjacent seals/apertures is 200mm.
- 5) Pipes must be installed singular, cables require no minimum separation.
- 6) Services in walls and floors shall be supported at the distances specified in Annex C from the face of the separating element.
- 7) The provisions made in this European Technical Assessment are based on an assumed working life of the ASTRO HPE Sealant of 10 years, provided that the conditions laid down in the product data sheet for the packaging/transport/ storage/installation/use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

Use Category

Type Z_1 : Intended for use in internal conditions with humidity equal to or higher than 85% RH excluding temperatures below 0°C, without exposure to rain or UV.

3 Performance of The Product And References To The Methods Used For Its Assessment

2	Safety in case of fire			
	Reaction to fire	See Clause 3.1.1		
	Resistance to fire	See clause 3.1.2		
3	Hygiene, Health and the Environment			
	Air permeability	See clause 3.2.1		
	Content and release of dangerous substances	See clause 3.2.2		
4	Safety and accessibility in use			
	Durability and serviceability	See clause 3.3.1		
5	Protection against noise			
	Airborne sound insulation	See clause 3.4		

3.1 Safety in case of fire

3.1.1 Reaction to fire

No performance assessed

3.1.2 Resistance to fire

ASTRO HPE Sealant has been tested in accordance with BS EN 1366-3: 2009 based upon the test results and the field of direct application specified within EN 1366-3: 2009, the ASTRO HPE Sealant has been classified in accordance with EN 13501-2, as given in Annex C:

The seals may only be penetrated by the services described in Annex C; other parts or support constructions must not penetrate the seal.

The service support construction must be fixed to the building element containing the penetration seal or a suitable adjacent building element, in such a manner that in the case of fire, no additional load is imposed on the seal. Furthermore it is assumed that the unexposed face support is maintained for the required period of fire resistance.

Pipes must be perpendicular to the seal surface.

It is assumed that compressed air systems are switched off by other means in the case of fire.

The function of the pipe seal in case of pneumatic dispatch systems, pressurized air systems etc. is guaranteed only when the systems are shut off in case of fire.

The assessment does not cover the avoidance of destruction of the seal or of the abutting building element(s) by forces caused by temperature changes in case of fire. This has to be considered when designing the piping system.

The assessment does not address any risks associated with leakage of dangerous liquids or gases caused by failure of the pipe(s) in case of fire.

The durability assessment does not take account of the possible effect of substances permeating through the pipe on the penetration seal.

3.2 Hygiene, Health and the Environment.

3.2.1 Air permeability

ASTRO HPE Sealant has been tested in accordance with EN 1026 to provide the following results:

Product tested ASTRO HPE sealant				
	Results under positive chamber pressure		Results under ne	
Pressure (Pa)	Leakage (m³/h)	Leakage (m³/m²/h)	Leakage (m³/h)	Leakage (m³/m²/h)
50	0.2	5.6	0.3	8.3
100	0.4	11.1	0.6	16.7
150	0.7	19.4	0.9	25.0
200	1.0	27.8	1.2	33.3
250	1.1	30.6	1.6	44.4
300	1.2	33.3	1.9	52.8
450	2.2	61.1	2.7	75.0
600	2.4	66.7	3.4	94.4

3.2.2. Content and release of Dangerous Substances

The applicant has presented a declaration that Astro Batt and Coating is in compliance with Council Directive 76/769/EEC of 27th July 1976 on the approximation of the laws, regulations and administrative provisions of the Member States relating to restrictions on the marketing and use of certain dangerous substances and preparations (incl. all amendments and adaptations).

Confirmation has further been declared that all dangerous chemical substances ≥ 1.0 % w/w as well as all toxic, carcinogenic, toxic for reproduction and mutagenic chemical substances ≥ 0.1 % w/w (Status: 29. adaption -2004/73/EG - of the EU directive 67/548/EEC - classification, packaging and labelling of dangerous substances) are stated in the Astro Batt and Coating material safety data sheets (according to 91/155/EEC including amendments) and have been considered for the classification of the products according to the directive 1999/45/EG (classification of preparations, including amendments).

All dangerous chemical substances are below the classification limits of 67/548/EEC.

In addition to the specific clauses relating to dangerous substances contained in this European technical approval, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations, and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.3 Safety and accessibility in use

3.3.1 Durability

ASTRO HPE SEALANT has been tested in accordance with EOTA Technical Report - TR024 - EAD 350454-00-1104 - Firestopping and fire sealing products - Penetration Seals, for the type X, and the results of the tests have demonstrated suitability for penetration seals intended for use in conditions exposed to weathering.

3.4 Protection against noise

3.4.1 The results of the test provided the following single number rating:

$$Rw(C:Ctr)=52(-1:-6)$$

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the decision 1999/454/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to the Regulation (EU) No 305/2011) given in the following table apply:

Products	Intended use(s)	AVCP System		
Fire stopping and fire sealing products	For fire compartmentation and / or fire protection or fire performance	System 1		

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark A/S prior to CE marking

Issued in Copenhagen on 2023-xx-xx by

Thomas Bruun

Managing Director, ETA-Danmark

Annex A

Reference Documents

EN 13501-1	Fire classification of construction products and building elements – Part 1: Classification using test data from reaction to fire tests
EN 13501-2	Fire classification of construction products and building elements – Part 2: Classification using test data from fire resistance tests
EOTA TR 024	Characterisation, Aspects of Durability and Factory Production Control for Reactive Materials, Components and Products

Annex B

Description of Product


ASTRO HPE Sealant

A detailed specification of the product is held on file by ETA-Danmark A/S

Annex C Resistance to fire classifications

C.1 Flexible or Rigid Walls Minimum Thickness 100 mm


C.1.1 Plastic pipes

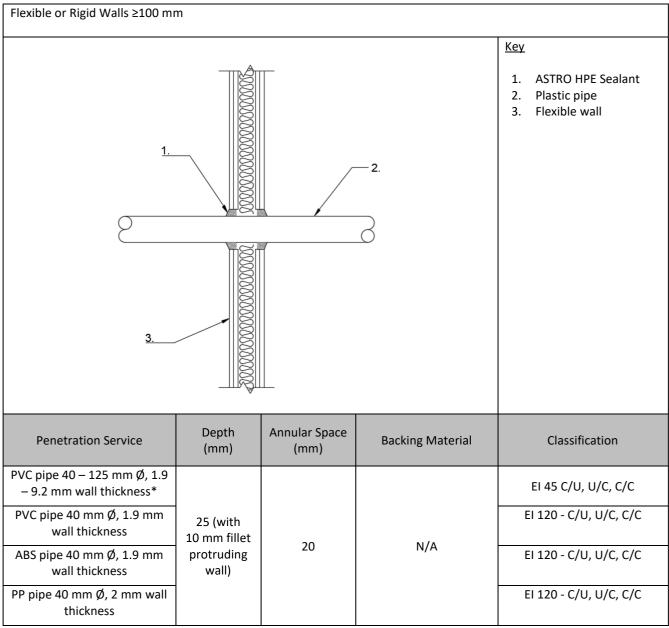


^{*}Typical pipe diameters shown, see below graph for intermediate sizes


All services supported with 'Unistrut' pipe supports at 260 mm from both faces of the wall.

PVC-U Pipes - EI 45 C/U

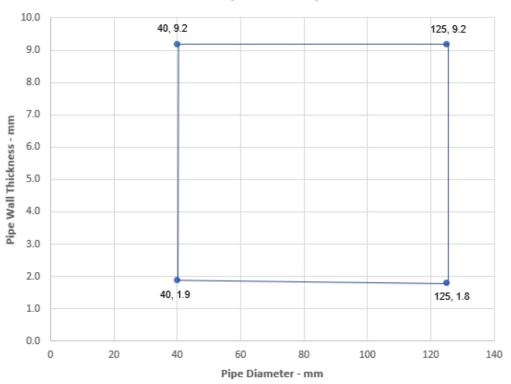


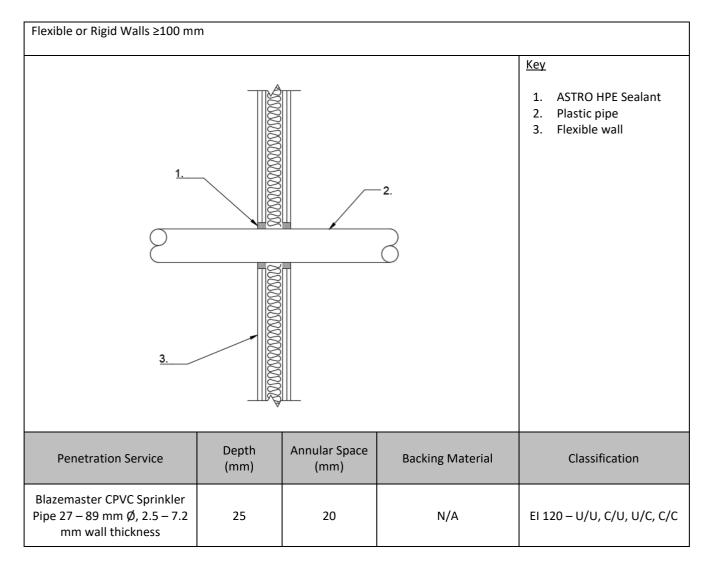

All services supported with pipe and cable supports at 425 mm from both faces of the wall.

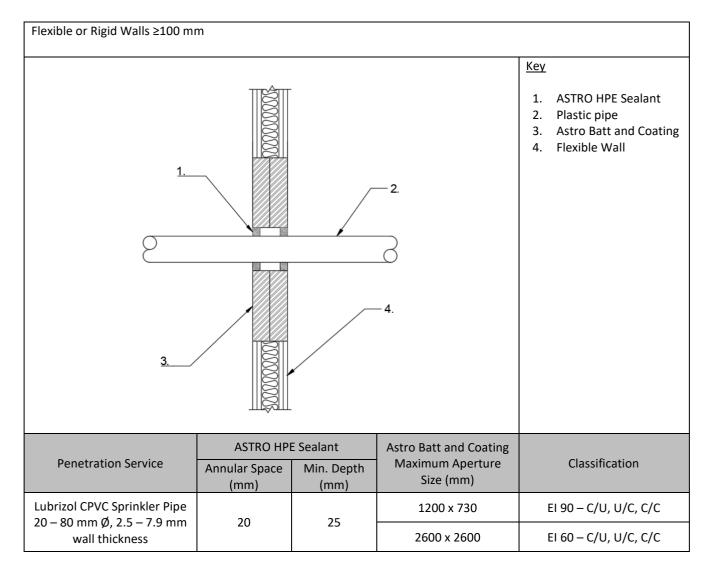

All services supported with pipe and cable supports at 425 mm from both faces of the wall.

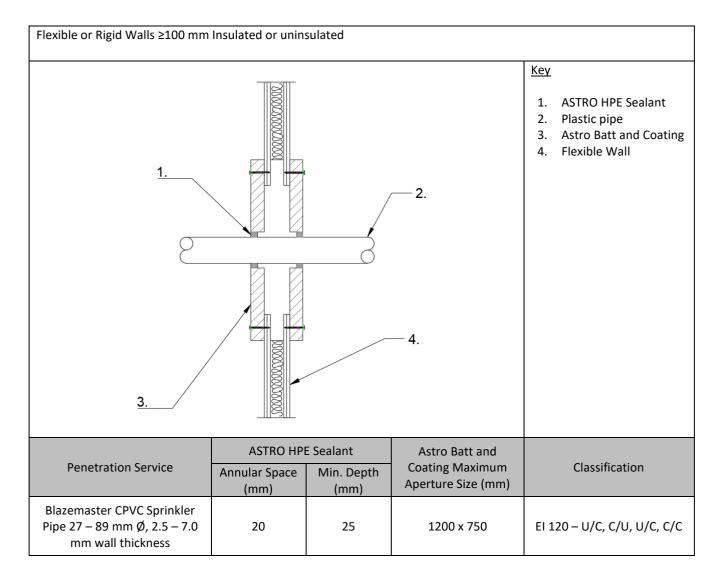

All services supported with pipe and cable supports at 425 mm from both faces of the wall.

C.1.2 Cables, Metallic Pipes, Insulated metallic pipes

Flexible or Rigid Walls ≥100 mm				
1	\$00000000000000000000000000000000000000		2.	1. ASTRO HPE Sealant 2. Insulated metal pipe 3. Flexible wall
Penetration Service	Depth (mm)	Annular Space (mm)	Backing Material	Classification
Copper 159 mm Ø, 2 -14.2 mm wall thickness with ≥30 mm thick ≥80kg/m³ foil faced glass wool (LS*, CS**) Copper 40 – 159 mm Ø, 2 -14.2 mm wall thickness with 32 mm thick 96kg/m³ Armaflex pipe insulation (LS*, CS**)	25 (with 10 mm fillet protruding wall)	20	N/A	E 120, EI 30 – C/U, C/C

All services supported with 'Unistrut' pipe supports at 260 mm from both faces of the wall.

^{*} Continuous through seal and extending minimum 650 mm from both faces of the seal (LS)

^{**} Continuous through seal and full length of the pipe (CS)


Flexible or Rigid Walls ≥100 mm <u>Key</u> 1. ASTRO HPE Sealant 2. Insulated metal pipe 3. Astro Batt and Coating 4. Flexible wall 2. **ASTRO HPE Sealant** Astro Batt and **Penetration Service** Classification Coating Maximum Annular Space Min. Depth Aperture Size (mm) (mm) (mm) Copper/Steel pipe 40 mm Ø 1.5 mm – 14.2 mm wall thickness, insulated with ≥20 15 2600 x 2600 EI 60 - C/C 15 mm thick foil faced glass wool insulation ≥80kg/m³ (CS) **Continued Sustained** Copper/Steel pipe 40mm -159mm Ø 1.5mm – 14.2 mm wall thickness*, insulated with 15 15 1200 x 730 EI 60 - C/C ≥30mm thick foil faced glass wool insulation ≥80kg/m³ (CS)


Continued Sustained

All services supported with pipe and cable supports at 250 mm from both faces of the wall.

^{*}Typical pipe diameters shown, see below graph for intermediate sizes

Copper or Steel Pipes with Glass Wool Insulation EI 60 C/C

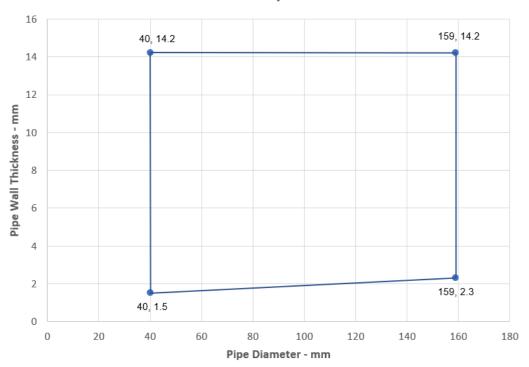

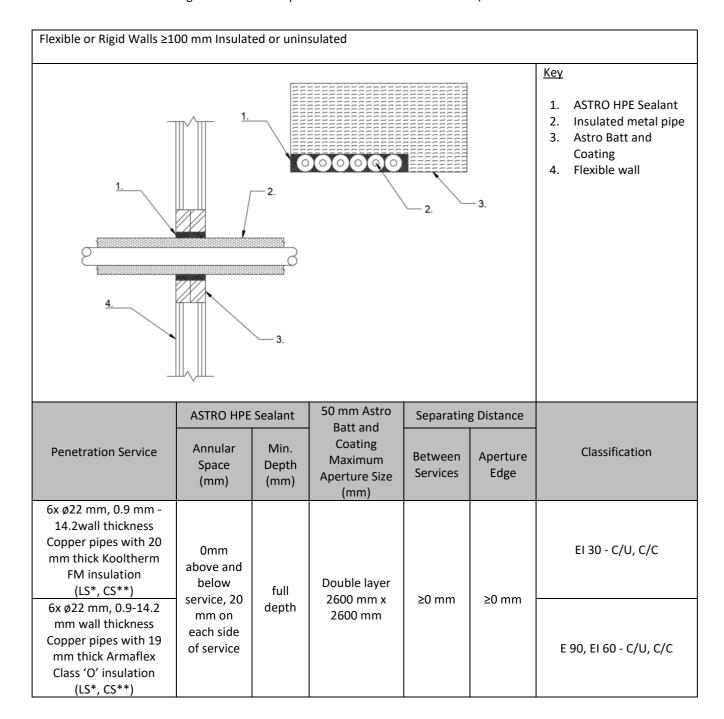


All services supported with 'Unistrut' pipe and cable supports at 400 mm from both faces of the wall.

^{*} Continuous through seal and extending minimum 450 mm from both faces of the seal (LS)

^{**} Continuous through seal and full length of the pipe (CS)

C.2 Flexible or Rigid Walls Minimum Thickness 120 mm


C.2.1 Plastic pipes

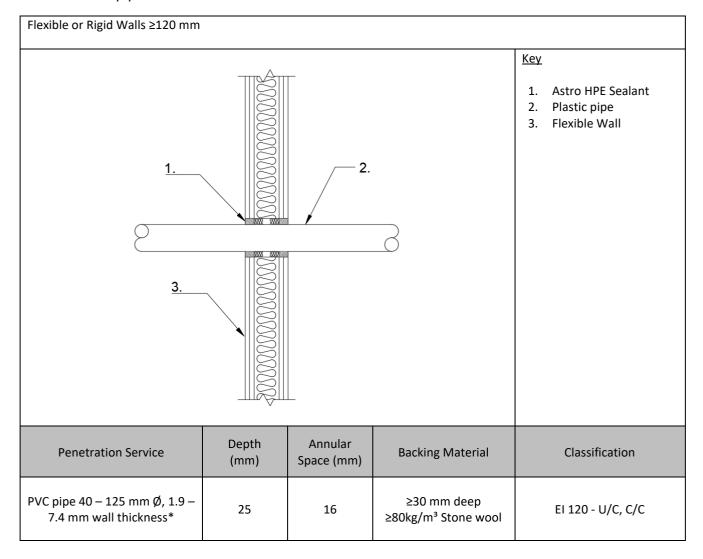


^{*}Typical pipe diameters shown, see below graph for intermediate sizes


All services supported with 'Unistrut' pipe supports at 150 mm from both faces of the wall.

PVC-U Pipes - EI 120 U/C

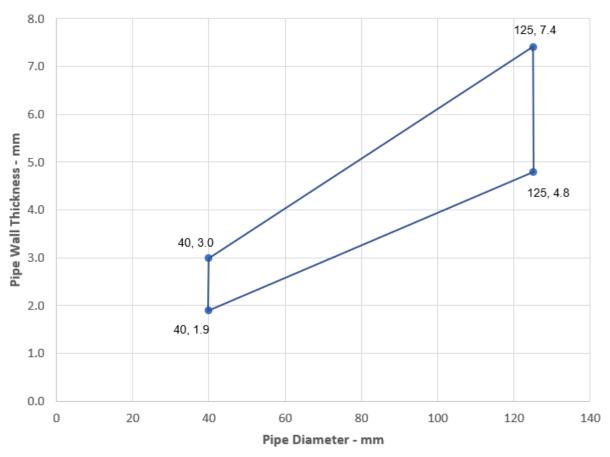


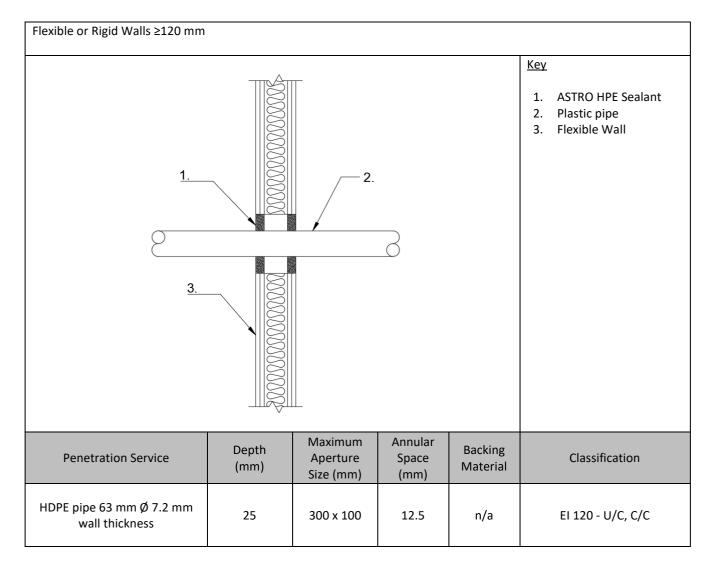

All services supported with 'Unistrut' pipe supports at 150 mm from both faces of the wall.

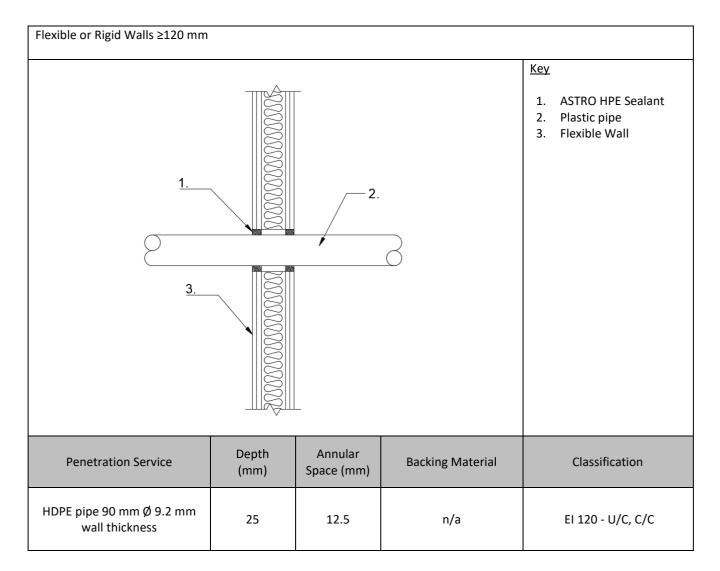


All services supported with 'Unistrut' pipe and cable supports at 150 mm from both faces of the wall.

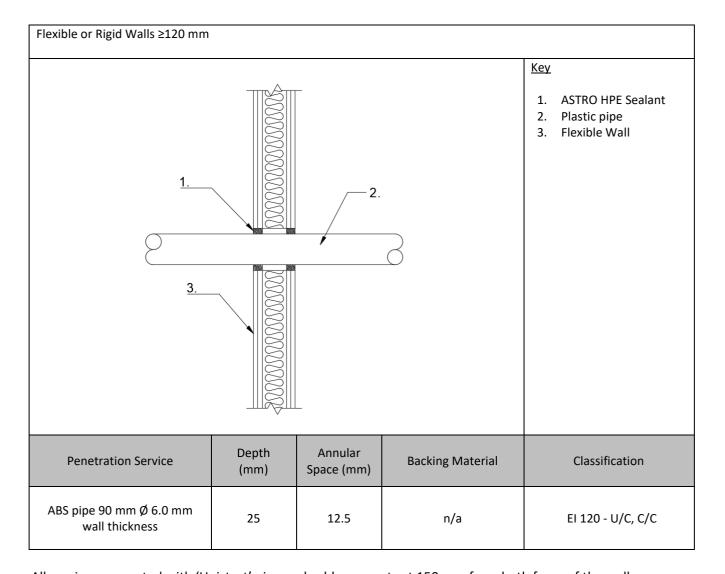

All services supported with 'Unistrut' pipe and cable supports at 150 mm from both faces of the wall.


C.2.2 Insulated metallic pipes

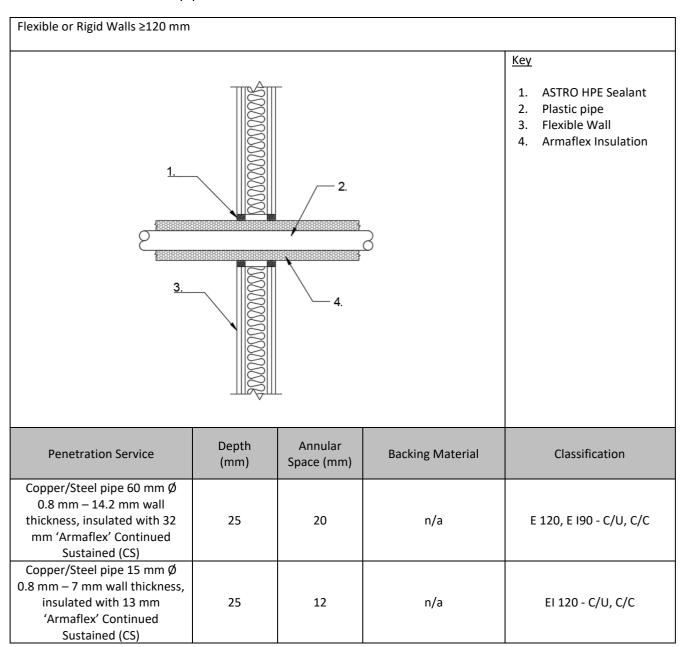

All services supported with 'Unistrut' pipe and cable supports at 150 mm from both faces of the wall.

C.3 Rigid Walls Minimum Thickness 150 mm


C.3.1 Plastic pipes

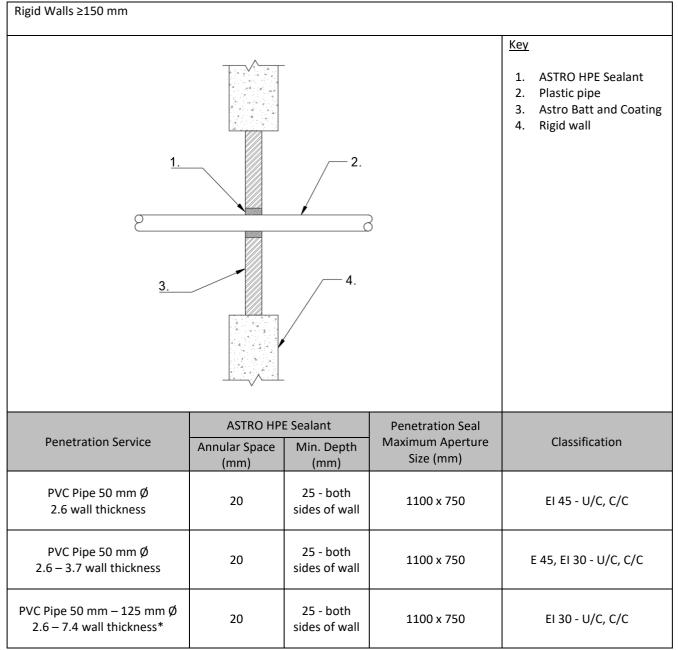

^{*}Typical pipe diameters shown, see below graph for intermediate sizes

All services supported with 'Unistrut' pipe and cable supports at 400 mm from both faces of the wall.

PVC-U Pipes - EI 30 U/C

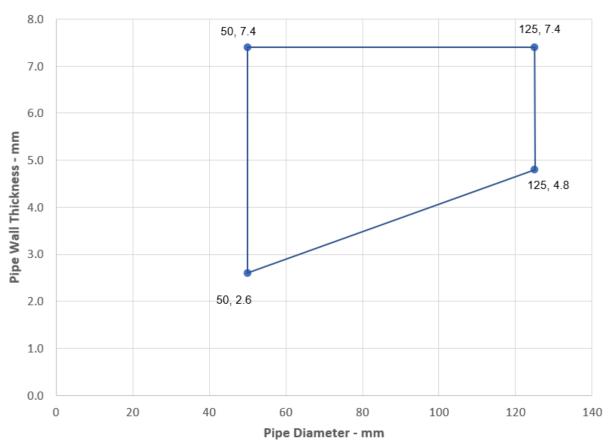


Rigid Walls ≥150 mm <u>Key</u> 1. ASTRO HPE Sealant 2. Plastic pipe 3. Astro Batt and Coating 4. Rigid wall **ASTRO HPE Sealant** Penetration Seal **Penetration Service** Maximum Aperture Classification **Annular Space** Min. Depth Size (mm) (mm) (mm) PVC Pipe 50 mm Ø 2.6 – 7.4 mm wall thickness* EI 120 - U/C, C/C PVC Pipe 125 mm Ø 25 - both 20 1200 x 730 7.4 mm wall thickness sides of wall PVC Pipe 50 mm – 125 mm Ø E 120, EI 90 - U/C, C/C 2.6 - 7.4 mm wall thickness* PVC Pipe 50 mm Ø 2.6 – 7.4 mm wall thickness PVC Pipe 125 mm Ø 25 - both 20 EI 60 - U/C, C/C 2600 x 2600 7.4 mm wall thickness sides of wall PVC Pipe 50 mm – 125 mm Ø 2.6 – 7.4 mm wall thickness*


All services supported with 'Unistrut' pipe and cable supports at 400 mm from both faces of the wall.

^{*}Typical pipe diameters shown, see below graph for intermediate sizes


PVC-U Pipes - EI 120 U/C

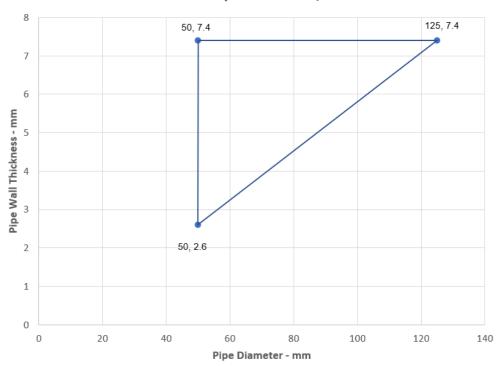

PVC-U Pipes - E 120, EI 90 U/C

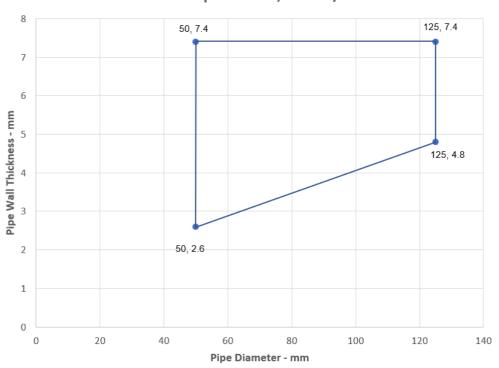

PVC-U Pipes - EI 60 U/C

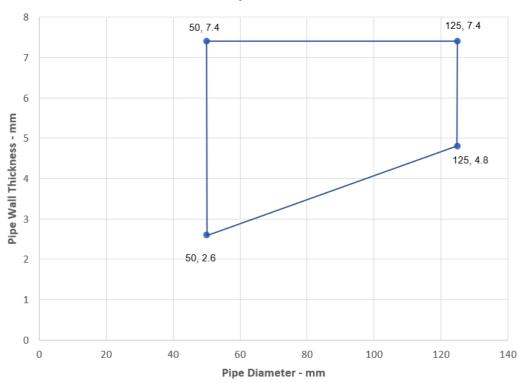


C.3.2 Multi layered pipes

Rigid Walls ≥150 mm					
				Key	
1				1. 2. 3. 4.	ASTRO HPE Sealant MLC pipe Astro Batt and Coating Rigid wall
	ASTRO HPE Sealant		Penetration Seal		
Penetration Service	Annular Space (mm)	Min. Depth (mm)	Maximum Aperture Size (mm)		Classification
Uponor MLC (Multi-Layer Composite) Pipe 40 mm – 110 mm Ø 4 mm – 10 mm wall thickness*	20	25 - both sides of wall	1100 x 750	E 4	5, EI30 - C/U, U/C & C/C

^{*}Typical pipe diameters shown, see below graph for intermediate sizes

All services supported with 'Unistrut' pipe and cable supports at 400 mm from both faces of the wall.


MLC Pipes - E 45, EI 30 C/U

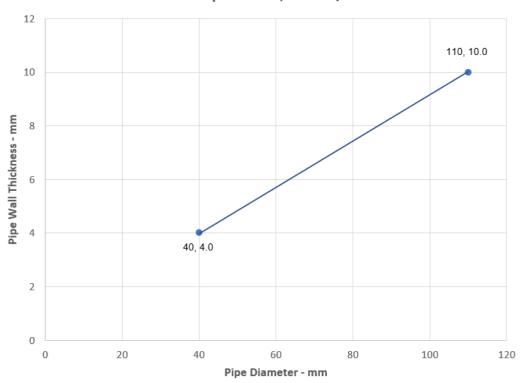


Rigid Walls ≥150 mm <u>Key</u> 1. ASTRO HPE Sealant 2. Plastic pipe 3. Astro Batt and Coating 4. Rigid wall ASTRO HPE Sealant Penetration Seal Classification **Penetration Service** Maximum Aperture Annular Space Min. Depth Size (mm) (mm) (mm) 1200 x 730 EI 120 – U/C, C/C Uponor MLC (Multi-Layer Composite) Pipe 40 mm – 25 - both 20 110 mm Ø sides of wall 4 mm - 10 mm wall thickness* EI 60 - U/C, C/C 2600 x 2600

All services supported with 'Unistrut' pipe and cable supports at 400 mm from both faces of the wall.


^{*}Typical pipe diameters shown, see below graph for intermediate sizes

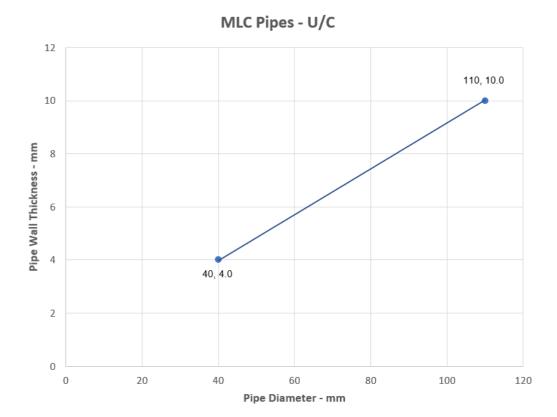

C.3.3 Cables

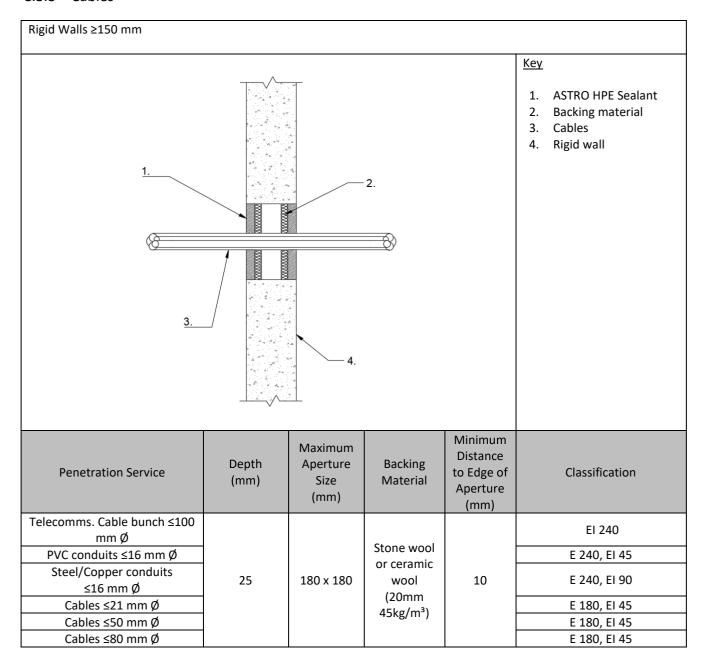

All services supported with 'Unistrut' pipe and cable supports at 400 mm from both faces of the wall.

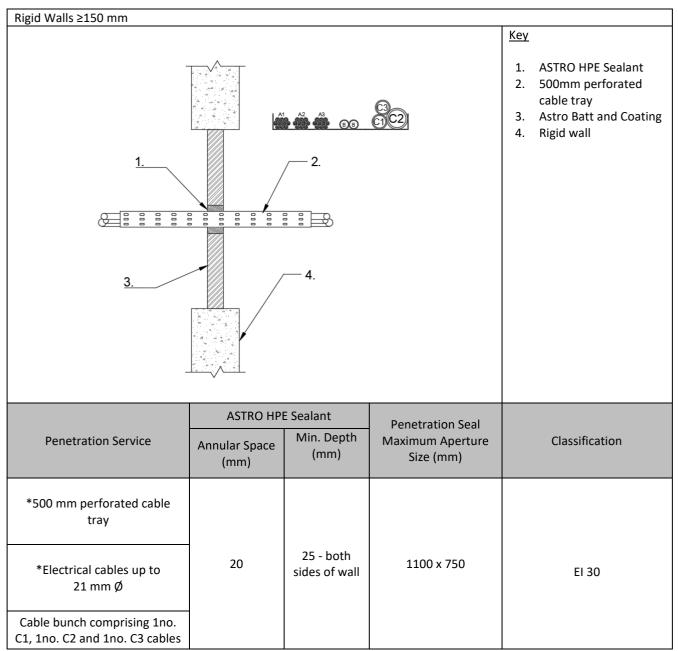

^{*}All cables coated with 2mm DFT PST Coating 300mm along the cables both sides of the seal

Rigid Walls ≥150 mm <u>Key</u> 1. ASTRO HPE Sealant 2. 500mm perforated cable tray 3. Astro Batt and Coating Rigid wall **ASTRO HPE Sealant** Penetration Seal **Penetration Service** Maximum Aperture Classification Annular Min. Depth Size (mm) Space (mm) (mm) *500 mm perforated cable tray EI 120 *Electrical cables up to 21 mm Ø 1200 x 730 25 - both *Cable bunch comprising 1no. C1, 20 sides of E 120, EI 90 1no. C2 and 1no. C3 cables wall *500 mm perforated cable tray 2600 x 2600 *Electrical cables up to 21 mm Ø EI 60 *Electrical cables up to 50 mm \emptyset

^{*}All cables coated with 2mm DFT PST Coating 300mm along the cables both sides of the seal


C.3.4 Metallic pipes

Rigid Walls ≥150 mm							
1	1. 2. 3. 4.	ASTRO HPE Sealant Metal pipe Astro Batt and Coating Rigid wall					
Penetration Service	ASTRO HPI Annular Space (mm)	E Sealant Min. Depth (mm)	Penetration Seal Maximum Aperture Size (mm)		Classification		
Copper/Steel pipe 40 mm – 159mm Ø 1.2mm – 14.2 mm wall thickness*	20	25 - both sides of wall	1100 x 750	E	E 45, EI 20 – C/U, C/C		
Copper/Steel pipe 40 mm Ø 1.2mm – 14.2 mm wall thickness					EI 45 - C/U, C/C		

^{*}Typical pipe diameters shown, see below graph for intermediate sizes

All services supported with 'Unistrut' pipe and cable supports at 400 mm from both faces of the wall.




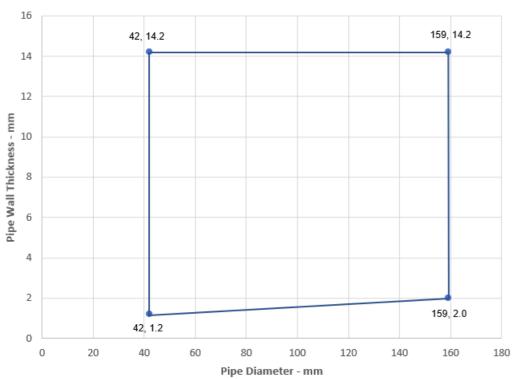

Rigid Walls ≥150 mm <u>Key</u> 1. ASTRO HPE Sealant 2. Metal pipe 3. Astro Batt and Coating 4. Rigid wall ASTRO HPE Sealant Penetration Seal Penetration Service Maximum Aperture Classification Annular Space Min. Depth Size (mm) (mm) (mm) Copper/Steel pipe 42 mm -159mm Ø 1.2mm – 14.2 mm E 120, EI 30 – C/U, C/C wall thickness* 1100 x 750 Copper/Steel pipe 42 mm Ø 25 - both 20 sides of wall 1.2 mm – 14.2 mm wall E 120, EI 60 – C/U, C/C thickness Copper/Steel pipe 42 mm -159 mm Ø 1.2 mm – 14.2 mm 2600 x 2600 EI 60 – C/U, C/C wall thickness


^{*}Typical pipe diameters shown, see below graph for intermediate sizes



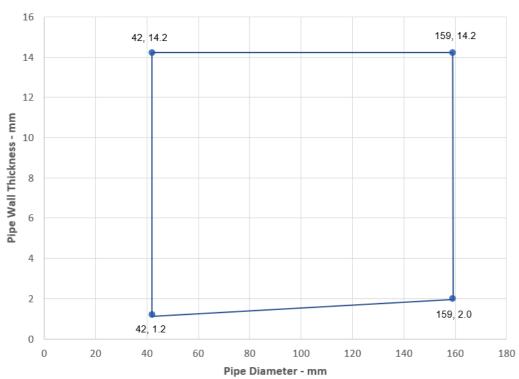


C.4 Rigid Floors Minimum Thickness 150 mm

C.4.1 Plastic pipes

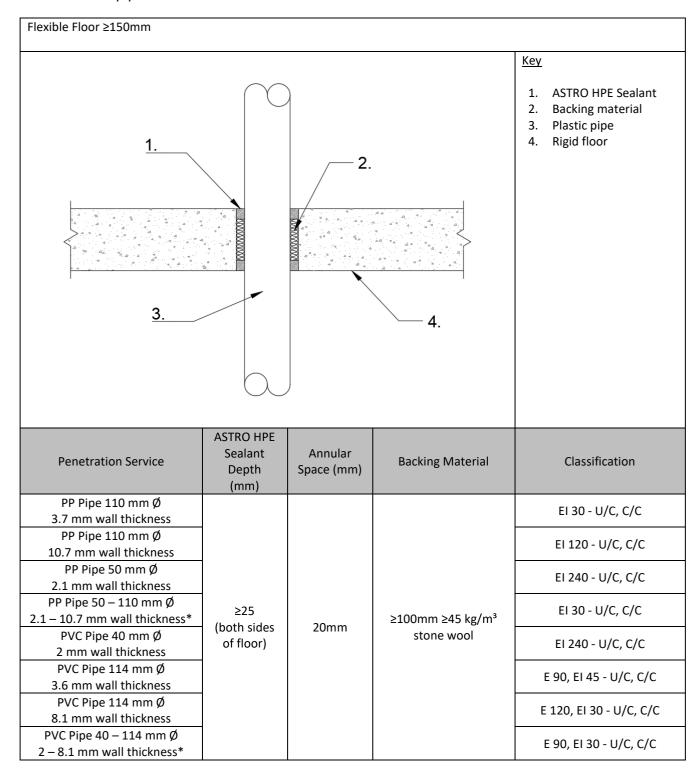


Penetration Service	ASTRO HPE Sealant Depth (mm)	Annular Space (mm)	Backing Material	Classification
PE Pipe 40 mm Ø 4.1 mm wall thickness	≥25 (both sides of floor)	15	≥100mm ≥45 kg/m³ stone wool	EI 240 - U/C, C/C
PE Pipe 125 mm Ø 7.6 mm wall thickness				EI 60 - U/C, C/C
PE Pipe 125 mm Ø 11.4 mm wall thickness				EI 90 - U/C, C/C
PE Pipe 40 – 125 mm Ø 4.1 – 11.4 mm wall thickness*				EI 60 - U/C, C/C


^{*}Typical pipe diameters shown, see below graph for intermediate sizes

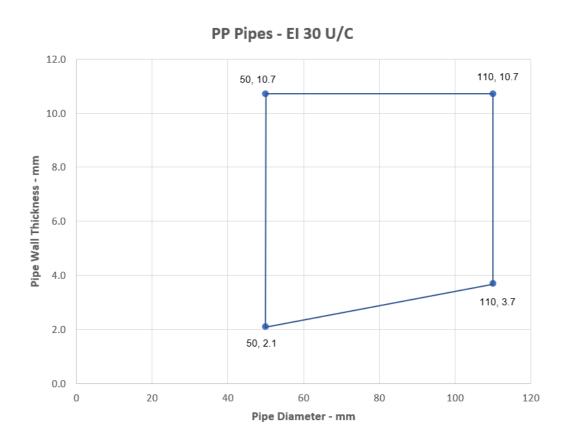


PVC Pipes - E 90, EI 45 U/C

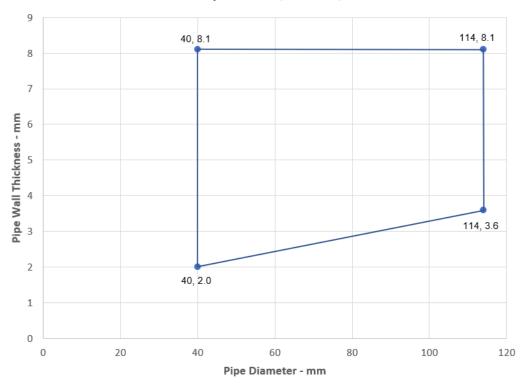


PE Pipes - EI 60 U/C

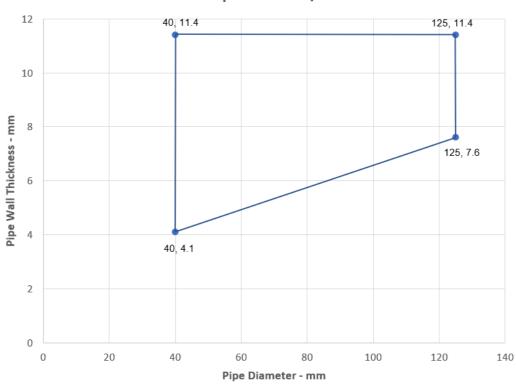

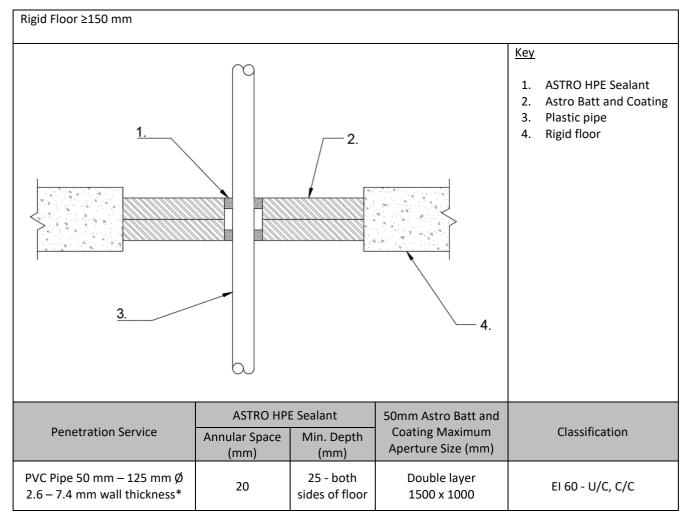


^{*}Typical pipe diameters shown, see below graph for intermediate sizes




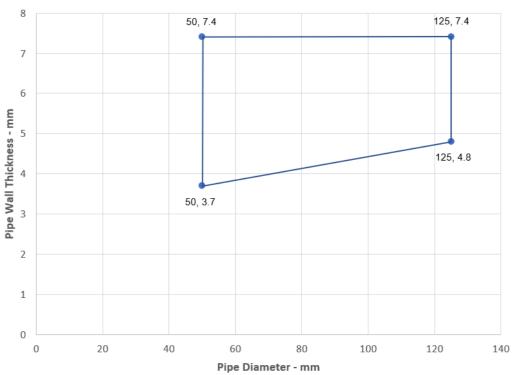


C.4.2 Multi layered pipes

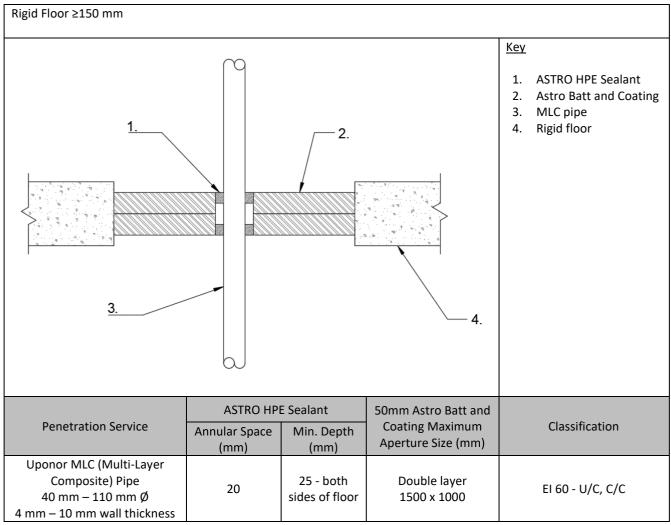


^{*}Typical pipe diameters shown, see below graph for intermediate sizes

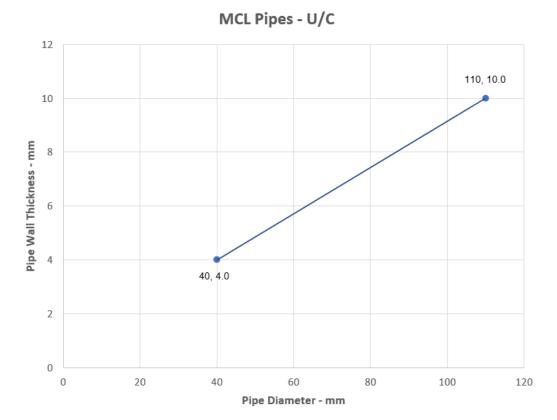

C.4.3 Cables

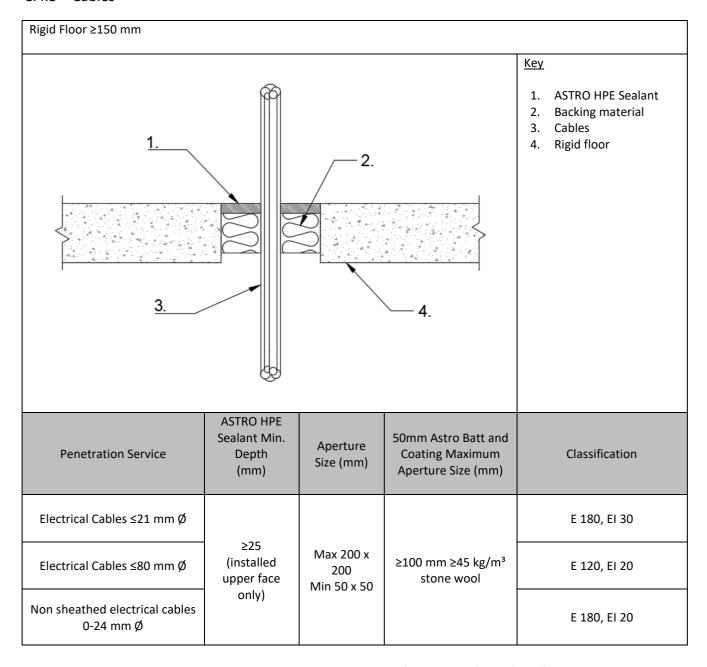

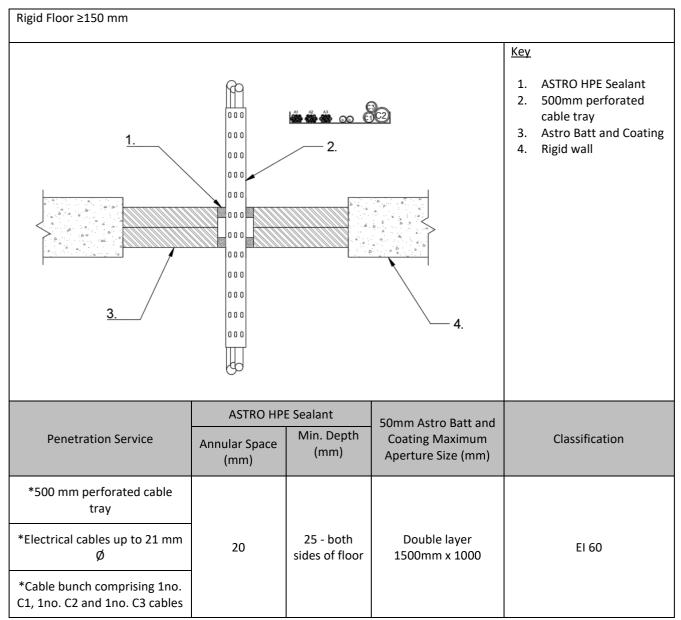

^{*}All cables coated with 2 mm DFT PST Coating 300 mm along the cables both sides of the seal

C.4.4 Insulated metal pipes

